



Standard Director's Chair

Bleeding area 
Safe visible area 


Keep all important graphics inside the safe visible areas
All text & strokes must be outlined
Any pixel-based artwork must be a minimum of 100dpi

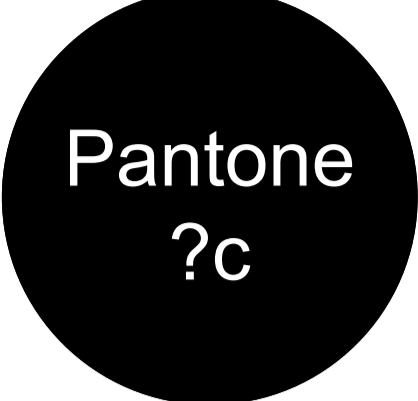

Chair Back (Inside)
420mm x 210mm



Chair Back (Outside)
700mm x 210mm



Chair Seat
600mm x 430mm

